



BULGARKONTROLA

BULGARKONTROLA SA -Sofia

Conformity Assessment Body for Construction Products

With identification number 14 and Permit № ПООСП-14 on 15.09.2016

Issued by Ministry of Regional Development and Public Works

CERTIFICATE OF CONFORMITY

14 – НУРВСПРБ –3772

Issued pursuant to Art. 14, par.1 and par.2 of the Regulation № ПД-02-20-1 on 05.02.2015 on the terms and conditions for use of construction products in the construction of the Republic of Bulgaria on Ministry of Regional Development and Public Works for the **construction product**

Pipes made of high-density polyethylene (HDPE 100)

Color black with blue stripes

are designed for piping systems for water supply, and for drainage and sewerage under pressure, with nominal dimension, operating pressure and evaluated characteristics in accordance with national requirements as per Supplement № 1 to this Certificate.

place on the market by

PEŠTA N d.o.o.

1300 Kaplara 189, 34301 Bucovik , Serbia

manufactured by

PEŠTA N d.o.o.

1300 Kaplara 189, 34301 Bucovik , Serbia

This certificate certifies that the product has been evaluated and meets national requirements set out in

BDS EN 12201-2:2011+A1:2013

BDS EN 12201-2:2011+A1:2013/NA:2014

*and item 2 of Annex 2 to item 2 of Order № 02-14-1329 from 03.12.2015,
of the Minister of Regional Development and Public Works*


The certificate was issued on **01/02/2023** cancel the Certificate № 14-НУРВСПРБ-3393 from 27/04/2020 and remains valid for three years until **31/01/2026**, provided that the manufacturer ensures consistency of product characteristics and the conditions of production or production control have not been changed significantly.

Place: Sofia

Date: 01/02/2023

Director of "Conformity Assessment" Dept.

[Signature]
/T. Lyubenova/

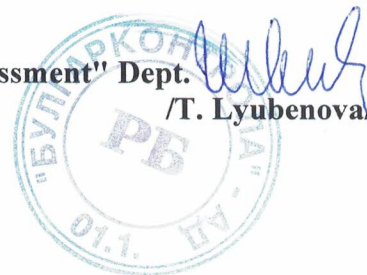



1. Размери и налягане

Номинален размер DN/OD (mm)	SDR	Работно налягане PN (bar)
315 ÷ 1200	41	4
50 ÷ 1200	26	6
40 ÷ 1200	21	8
32 ÷ 1200	17	10
25 ÷ 1200	13,6	12,5
20 ÷ 1000	11	16
16 ÷ 800	9	20

2. Оценени характеристиките в съответствие с националните изисквания

Характеристика	Изискване за деклариране/ гранично ниво
Външен вид	с гладка и чиста повърхност , без шупли, съгласно т.5.1. БДС EN 12201-2:2011+A1:2013 БДС EN 12201-2:2011 +A1:2013/NA:2014
Цвят	черен със сини ивици съгласно т.5.2. БДС EN 12201-2:2011+A1:2013 БДС EN 12201-2:2011 +A1:2013/NA:2014
Геометрични характеристики, mm	Група 1: DN 20÷DN 75 mm Група 2: DN 75 ÷DN 250 mm Група 3: DN 250 ÷DN 710 mm Група 4: DN 710 ÷DN 1200 mm съгласно т.6, табл.1,2 БДС EN 12201-2:2011 +A1:2013 БДС EN 12201-2:2011 +A1:2013/NA:2014
Хидростатична якост (80 °C/165 h)	без течове и пробиви повече 165 h съгласно т.7, табл.3 БДС EN 12201-2:2011+A1:2013 БДС EN 12201-2:2011 +A1:2013/NA:2014
Удължение при скъсване, %	> 350 % съгласно т.7, табл.3 БДС EN 12201-2:2011+A1:2013 БДС EN 12201-2:2011 +A1:2013/NA:2014
Индекс на стопилка по маса (MFR), g/min 190°C, 5 kg/10min	± 20 % между MFR на суровината и тръбата съгласно т.8, табл.5 БДС EN 12201-2:2011+A1:2013 БДС EN 12201-2:2011 +A1:2013/NA:2014
Време до началото на окисляване (OIT), min	> 20 min съгласно т.8, табл.5 БДС EN 12201-2:2011+A1:2013 БДС EN 12201-2:2011 +A1:2013/NA:2014

Място: гр. София
Дата: 01.02.2023 г.

Директор на Дирекция „ОС”
/Т. Любенова /

